
GE-TITE FASCIA SYSTEI

ANSI / SPRI ES-1 WIND BLOW-OFF RESISTANCE OF 155 LBS./SQ.FT.

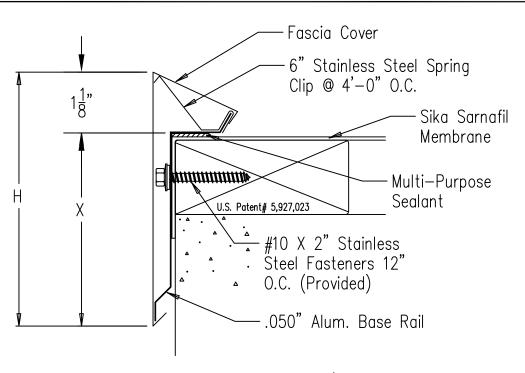

Fascia is to be installed per Specifications and Sika Sarnafil's Installation Instructions Dwg. # 14110-2819

EDGE-TITE FASCIA SYSTEM DIMENSIONS				MINIMUM 2 X 4 WOOD NAILERS REQUIRED
PRODUCT ID. NO.	H DIM.	X DIM.	NAILER COVERAGE	METALS:
□ ET-40 □ ET-50	4" 5"	2 7/8" 3 7/8"	1 NAILER 2 NAILERS	24 Ga. Galv. Steel040"
□ ET-65 □ ET-80	6 1/2" 8"	5 3/8" 6 7/8"	3 NAILERS 4 NAILERS	Color: Finish:
Fahricat	tion will proceed only after receipt of			OLIANITITICO.

Fabrication will proceed only after receipt of signed print approval.

Print Approval:

Architect and/or contractor shall verify all dimensions, sizes, and quantities. All products to be installed in strict accordance with Sika Sarnafil printed instructions.

Approved by:	
Date.	

VIL 17 (LO:							
24 Ga. Galv. Steel	040" Aluminum						
Color:	Finish:						

QUANTITES:

Lineal Feet (12'-0)")
Outside Miter(s) @	90°
Inside Miter(s) @	90°
Overflow Scupper	StyleAB
Spillout Scupper	StyleAB
Downspout Scupper	StyleAB
(X) Size	A: Tapered 1 1/2" Drop
	B: Flat
FOR NON-90 MITERS SEE PRINT A	PPROVAL #14010-2823

PROJECT	
ARCHITECT	
ROOFING CONTRACTOR	

Sika Sarnafil Inc. 100 Dan Road Canton, MA 02021 (800) 451-2504 Fax: (781) 828-5365 www.metalera.com/sikasarnafil



Sarnafil®

DATE: 03/28/17 SHT.#___ OF _ DRN BY: JAB DWG# 14010-2818 CKD BY: SAK