




FIBERTITE GRAVEL STOP WITH CONTINUOUS CLEAT


NOTES

- Includes concealed splice plates that must be field caulked to prevent water entry
- Unless otherwise noted, fabrication of miters and accessories are provided with a non-penetrating quicklock joint, then factory sealed watertight
- Welded miters and accessories require a minimum material thickness of .050"
- For non-90 miters, see separate print approval
- Product should be installed per provided installation instructions
- ANSI/SPRI/FM 4435/ES-1 Test Pressure up to 258 psf

FACE HEIGHT 6" OR LESS

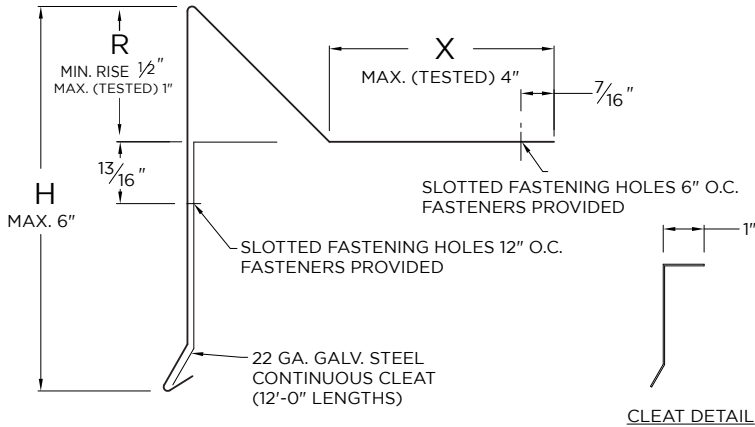

FACE HEIGHT OVER 6"

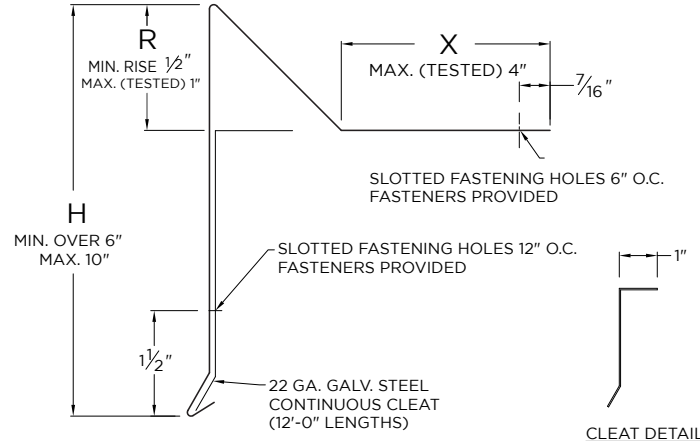

APPROVALS



ANSI/SPRI/FM 4435/ES-1
Test Pressures listed in notes

PROJECT INFO

Project Name: _____

Architect: _____

Roofing Contractor: _____

Project Type:

By selecting this box you have verified and confirmed that dimensions, sizes, and quantities are correct. All products will be installed in strict accordance with printed instructions.

Date: _____

FiberTite
Customer Service
1-800-355-6416

SHT# 1 of 1

DATE: 01/09/24

DRN BY: JJC

CKD BY: MM

DWG #: 23010-2525

REV: E

DIMENSIONS

- _____ (H) Face Height
- _____ (X) Flange Size
- _____ (R) Rise

MATERIAL

- 24 Ga. Galv. Steel
 - 22 Ga. Galv. Steel
 - .040" Aluminum
 - .050" Aluminum
 - .063" Aluminum
 - OTHER: _____
- Color: _____
Finish: _____
- Substrate:** Wood
If substrate is not given, wood fasteners will be provided. Masonry
 Metal

QUANTITIES

- _____ Lineal Feet (12'-0" Lengths)
- _____ Outside Miter (90°)
- _____ Inside Miter (90°)

- Accessory Type:
- Quicklock (Default)
 - Welded (Surcharge)